



State of New Hampshire  
DEPARTMENT OF ENVIRONMENTAL SERVICES

6 Hazen Drive, P.O. Box 95, Concord, NH 03302-0095  
(603) 271-2457 FAX (603) 271-7894



Steve Fongeallaz  
Wheelock Motor Court  
Route 3, PO Box E  
Woodstock, New Hampshire 03293

LETTER OF DEFICIENCY  
WMB PBF 02-50  
August 23, 2002

Dear Mr. Fongeallaz:

The Department of Environmental Services, Water Division ("DES") is required by RSA 485-A:26 to operate a program to ensure the health and safety of the public when using public bathing facilities such as pools and spas. To implement this program, DES has adopted administrative rules Env-Ws 1101-1105 to specify the design, operation, and maintenance requirements for public bathing facilities. DES reviews applications for new public bathing facilities and also inspects and tests the water in existing public bathing facilities to ensure that applicable requirements are being met.

On August 13, 2002, DES inspected the pool at the Wheelock Motor Court in Woodstock, NH ("the Pool"). During this inspection the following deficiencies were noted:

A recommendation to close and super chlorinate the Pool was issued on August 13, 2002. The inspection on August 13, 2002 revealed that the Pool was in violation of Env-Ws 1103.14 and unsafe for public use. The following bacterial violations were observed in the Pool water:

- (a) Pursuant to Env-Ws 1103.14(a)(1) the maximum allowable concentration of total coliform bacteria and *Escherichia coli* in public bathing facility water is zero counts per one hundred milliliters (0CTS/100mL). The Pool water contained 18 CTS/100mL of total coliform bacteria with *E. coli* bacteria present.
  - (b) The maximum allowable concentration of non-coliform bacteria in public bathing facility water is two hundred counts per one hundred milliliters (200 CTS/100mL). The Pool water contained greater than 200 CTS/100mL.
2. Env-Ws 1103.15(c) requires a free residual chlorine concentration between 1.0 mg/L and 3.0 mg/L in public pool water. The free chlorine residual of the Pool water was less than 0.1 mg/L on August 13, 2002.
  3. Pursuant to Env-Ws 1103.15(a), disinfection of pool water shall be achieved by positive displacement pump type unit providing hypochlorination or by an erosion unit using either hypo-chlorite or bromine tablets with control of the erosion rate. The Pool is currently being disinfected by hand feeding.
  4. Env-Ws 1104.01 requires the operator to test public bathing facility water for disinfectant residual, pH, and temperature prior to use of a public bathing facility and every 4 hours during operation, to record test results on a dated daily log sheet, and to maintain operational records for the previous twelve months and make these records available to DES and patrons of the public bathing facility upon request. No written records were available at the time of the inspection relative to the required testing of the Pool water.
  5. Env-Ws 1104.03(e)(1) states that the depth of water in feet shall be plainly and conspicuously marked at or above the water line on the vertical pool wall and on the top of the coping or edge of the deck or walk next to the pool. The depth of the Pool was not marked.
  6. Pursuant to Env-Ws 1103.11, all outdoor swimming pools shall have a wall, fence or other enclosure constructed around the entire pool or recreational area, which shall include self-closing and self-latching gates and shall be a minimum of 4 feet high measured on the inside and outside. The enclosure surrounding the Pool does not include self-closing and latching gates.

7. Env-Ws 1105.01(k)(19) requires pool filtration systems to include a flow meter. The filtration system for the Pool did not include a flow meter.
8. Pursuant to Env-Ws 1105.01(k)(8), suction outlets shall be provided with a cover that has been tested and approved by a nationally recognized testing laboratory. Flat grates under 10" diameter do not meet the requirements of ANSI/NSF Standard 50 or ASME/ANSI A112.19.8M ("Suction Fittings for use in Swimming Pools, Wading Pool, Spas, Hot Tubs, and Whirlpool Bath Applications"). The Pool has a flat grate under 10" diameter.

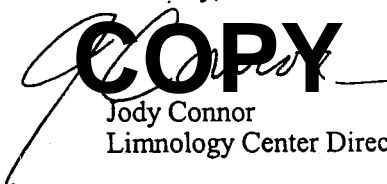
A report outlining how compliance will be achieved with the cited deficiencies should be submitted to DES within 30 calendar days from receipt of this letter. The report should include the following:

- A copy of two weeks of water quality test results for all facilities (please do not send originals).
- 2. The type, manufacture, and model of the chlorine feeder to be installed.
- 3. The type, manufacture, and model of the flow meter to be installed.
- 4. The type, manufacture, and model of the main drain cover to be installed.
- 5. A timetable of when:
  - a. the depth will be marked,
  - b. patron rules will be posted,
  - c. the installation of the chlorine feeder will be completed
  - d. the installation of the main drain cover will be completed, and
  - e. the installation of the flow meter will be completed.

DES personnel will conduct another inspection at a later date to determine whether you have come into, and are maintaining, full compliance with RSA 485-A:26 and Env-Ws 1101-1105. After a violation of Env-Ws 1103.14, the facility will be required to pass two inspection in the following months. In the event that compliance is not achieved, DES may take further action, including seeking an administrative fine up to \$2,000 for each offense or referring the case to the NH Attorney General's Office for judicial action.

We appreciate your cooperation in this matter. Please contact Amy Wilson at (603) 271-7108 if you have any questions regarding this letter. Copies of Env-Ws 1101-1105 are available through the DES Public Information Center at (603) 271-2975 or via the Internet at <http://www.des.state.nh.us/pools/env1100.pdf>.

Sincerely,

  
**COPY**  
Jody Connor  
Limnology Center Director

Mark Harbaugh, Enforcement Attorney, DES ✓  
Amy Wilson, Public Bathing Facility Coordinator, DES  
Barbara Mack-Keeney, Health Officer, Town of Woodstock